


A

IBI	SBP	MAP	TIME
0.047	130.1875	101.8958	10:36:54.602
0.118	130.0313	101.1667	10:36:54.649
0.125	128.2813	100.5729	10:36:54.767
0.119	127.2656	95.57813	10:36:54.892
0.116	125.75	99.6875	10:36:55.011
0.125	130.2188	100.4479	10:36:55.127
0.12	129.3906	98.06771	10:36:55.252
0.117	127.625	100.7396	10:36:55.372
0.12	131.6563	103.3438	10:36:55.489
0.119	134.6406	105.7865	10:36:55.609
0.123	135.4063	106.0521	10:36:55.728
0.123	134.9688	101.7604	10:36:55.851
0.117	134.25	105.25	10:36:55.974
0.12	133.8594	104.2135	10:36:56.091
0.12	132.1875	103.0833	10:36:56.211
0.12	132.1406	103.1719	10:36:56.331
0.122	132.6875	103.5938	10:36:56.451
0.119	131.4375	100.2188	10:36:56.573
0.12	131.6875	102.5625	10:36:56.692
0.117	130.5625	101.5833	10:36:56.812
0.121	130.8125	100.5417	10:36:56.929
0.118	133.5313	102.9583	10:36:57.050
0.115	133.7344	102.5573	10:36:57.168
0.126	134.6563	104.2813	10:36:57.283
0.12	134.0469	102.0573	10:36:57.409
0.121	134.8438	104.1667	10:36:57.529
0.117	134.1875	104.75	10:36:57.650
0.114	133.5	101.25	10:36:57.767
0.121	133.5938	103.4479	10:36:57.881
0.121	134.9063	105.1771	10:36:58.002
0.12	134.5625	104.4792	10:36:58.123

B

Blood Pressure type	SBP
Animal Number	
Date of Assessment - use 'dd-mm-yyyy' format	dd-mm-yyyy
Moving Average Window BP (seconds)	240
Moving Average Window HR (seconds)	240
Moving Average Threshold Transposition BP (mmHg)	20.0
Moving Average Threshold Transposition HR (bpm)	-40.0
Interpeak Interval BP (seconds)	2
Peak Cluster Interval BP (seconds)	10
AD Duration Threshold (seconds)	120
Heart Rate Drop Restriction (bpm)	40.0
Upper Heart Drop Average Range (initial +/-% of AD Event)	5.0
Lower Heart Drop Average Range (final % of AD Event)	75.0
Heart Rate Minimum (bpm)	180.0
Heart Rate Maximum (bpm)	625.0
Report Filename	AD Event Detection Report
<input type="button" value="OK"/> <input type="button" value="Cancel"/>	

C

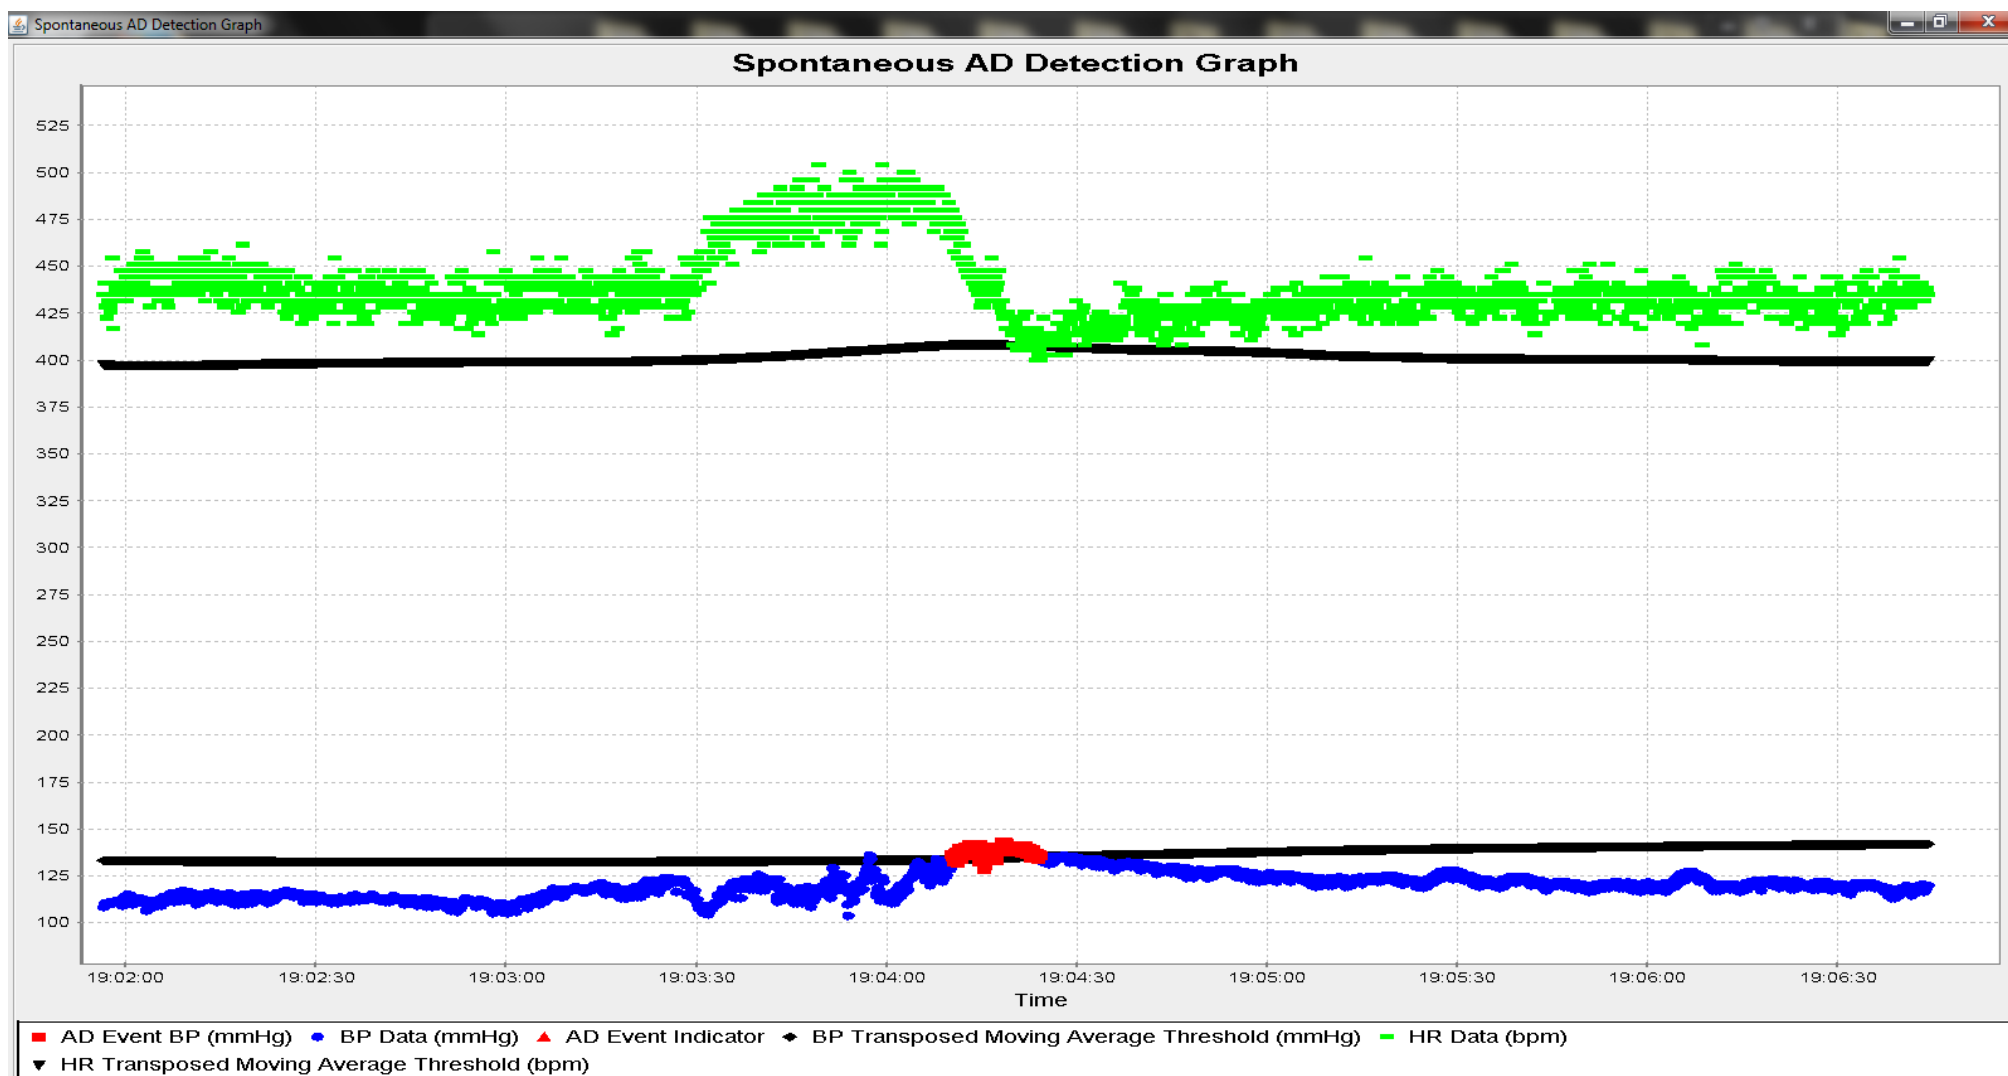

D

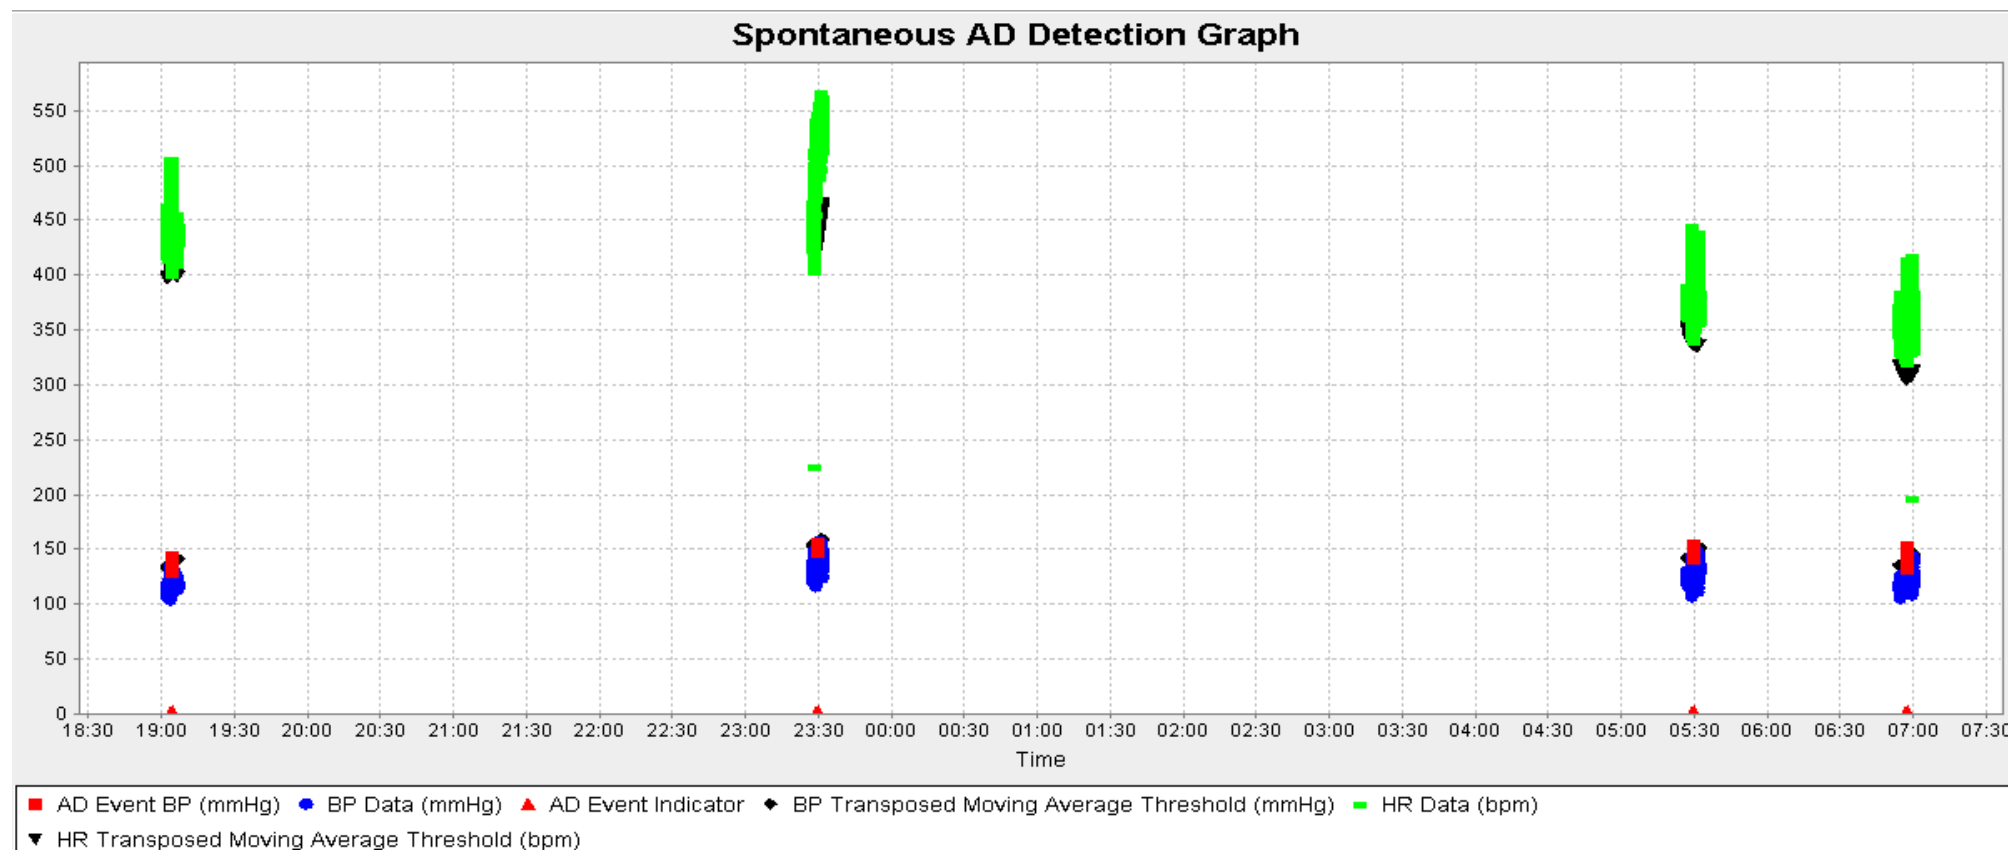


Figure 4