




Microbubbles after Vaporization When Condensed at Varying Temperatures

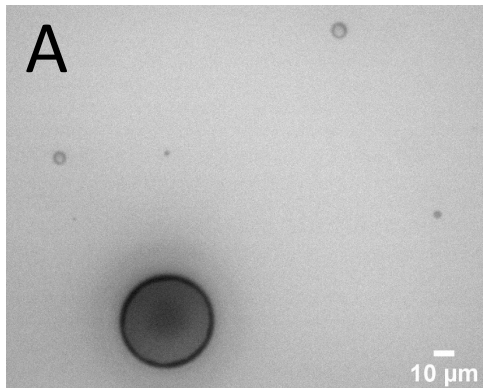

25°C

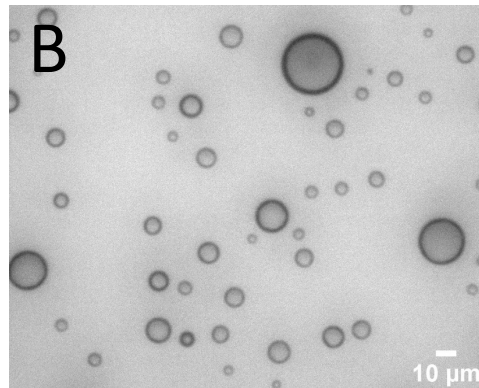

0°C

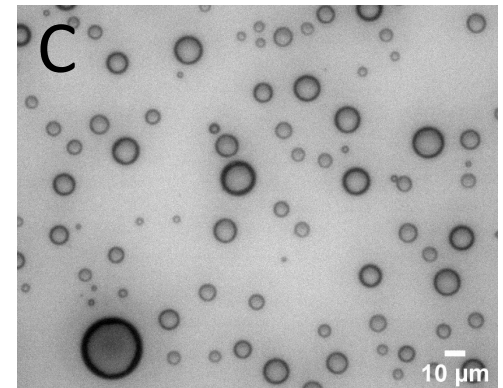

-18°C